

(12)

11/ASR  
711-45-TM  
130483  
P.17

FOLIAGE PLANTS FOR IMPROVING INDOOR AIR QUALITY

By:

B. C. Wolverton, Ph.D.

NATIONAL AERONAUTICS AND SPACE ADMINISTRATION

John C. Stennis Space Center

Stennis Space Center, MS 39529-6000

N93-70462

Unclass

Z9/45 0130483

Presented at:

National Foliage Foundation

Interiorscape Seminar

Hollywood, FL

July 19, 1988

(NASA-TM-108055) FOLIAGE PLANTS  
FOR IMPROVING INDOOR AIR QUALITY  
(NASA) 17 P

## BACKGROUND

Indoor air pollution and "sick building syndrome", byproducts of the 1970 energy crisis, have become household words. Two of the key ingredients which have contributed to today's potentially serious indoor air pollution problems are tightly constructed buildings with dramatically reduced ventilation rates and the radical change in the nature of building materials and household furnishings. Add to this, new household products such as cleaning and polishing solutions, insecticides, glues, personal hygiene and health care products along with numerous electronic devices and radon gas and you have the ingredients for serious health problems.

For more than 15 years, the National Aeronautics and Space Administration (NASA) has been aware of the potential indoor air pollution problems associated with completely closed structures in outer space (1). Other agencies and researchers have also confirmed the presence of large numbers of trace organics inside modern buildings (2-28). In anticipation of long term manned space flight during the next 10 to 20 years, NASA is evaluating the beneficial effects of having plants in future manned space operations. Both the psychological and physiological affects of plants on man when confined for long periods of time in a closed system are of interest to NASA. The photosynthetic process that allows plant to live and grown requires a continuous exchange of gaseous substances between plant leaves and the surrounding atmosphere. The most common gaseous substances exchanged are carbon dioxide, oxygen and water vapor. The plant leaves normally give off water vapors and oxygen and take in carbon dioxide. However, it appears that plant leaves can also take in other gaseous

substances from the surrounding atmosphere through tiny openings (stomates) on their leaves. Recent NASA studies have concentrated on determining the ability of plant leaves and plant roots to remove trace levels of toxic chemicals from closed experimental chambers. These same studies are also looking at the possibility that certain plants might give off trace levels of metabolites that could have undesirable effects on man in a completely closed system.

Studies to determine the ability of several types of plants to treat and recycle wastewater and remove trace levels of toxic chemicals from air inside closed chambers have been conducted by NASA for over 10 years (29-33). These studies at the Stennis Space Center (SSC) in south Mississippi have generated a great deal of public interest over the past several years because of the potential for this simple technology in treating domestic wastewater, industrial waste, controlling industrial air pollution and water reuse in addition to the promise of supplying an inexpensive means of indoor air pollution control. As a result of this public interest, in February 1988, NASA signed a jointly funded, two-year agreement with the Associated Landscape Contractors of America (ALCA) to evaluate the ability of certain foliage plants to remove indoor air pollutants such as formaldehyde, benzene, TCE and carbon monoxide from indoor environments. Previous NASA studies have demonstrated the ability of several varieties of houseplants to remove formaldehyde, benzene and carbon monoxide from sealed experimental chambers, Figures 1, 2, and 3 and Table 1. More recent studies under the NASA/ALCA joint agreement have produced additional data as shown in Table 2.

FIGURE 1

# Formaldehyde Reduction in Closed Chamber With and Without Plants

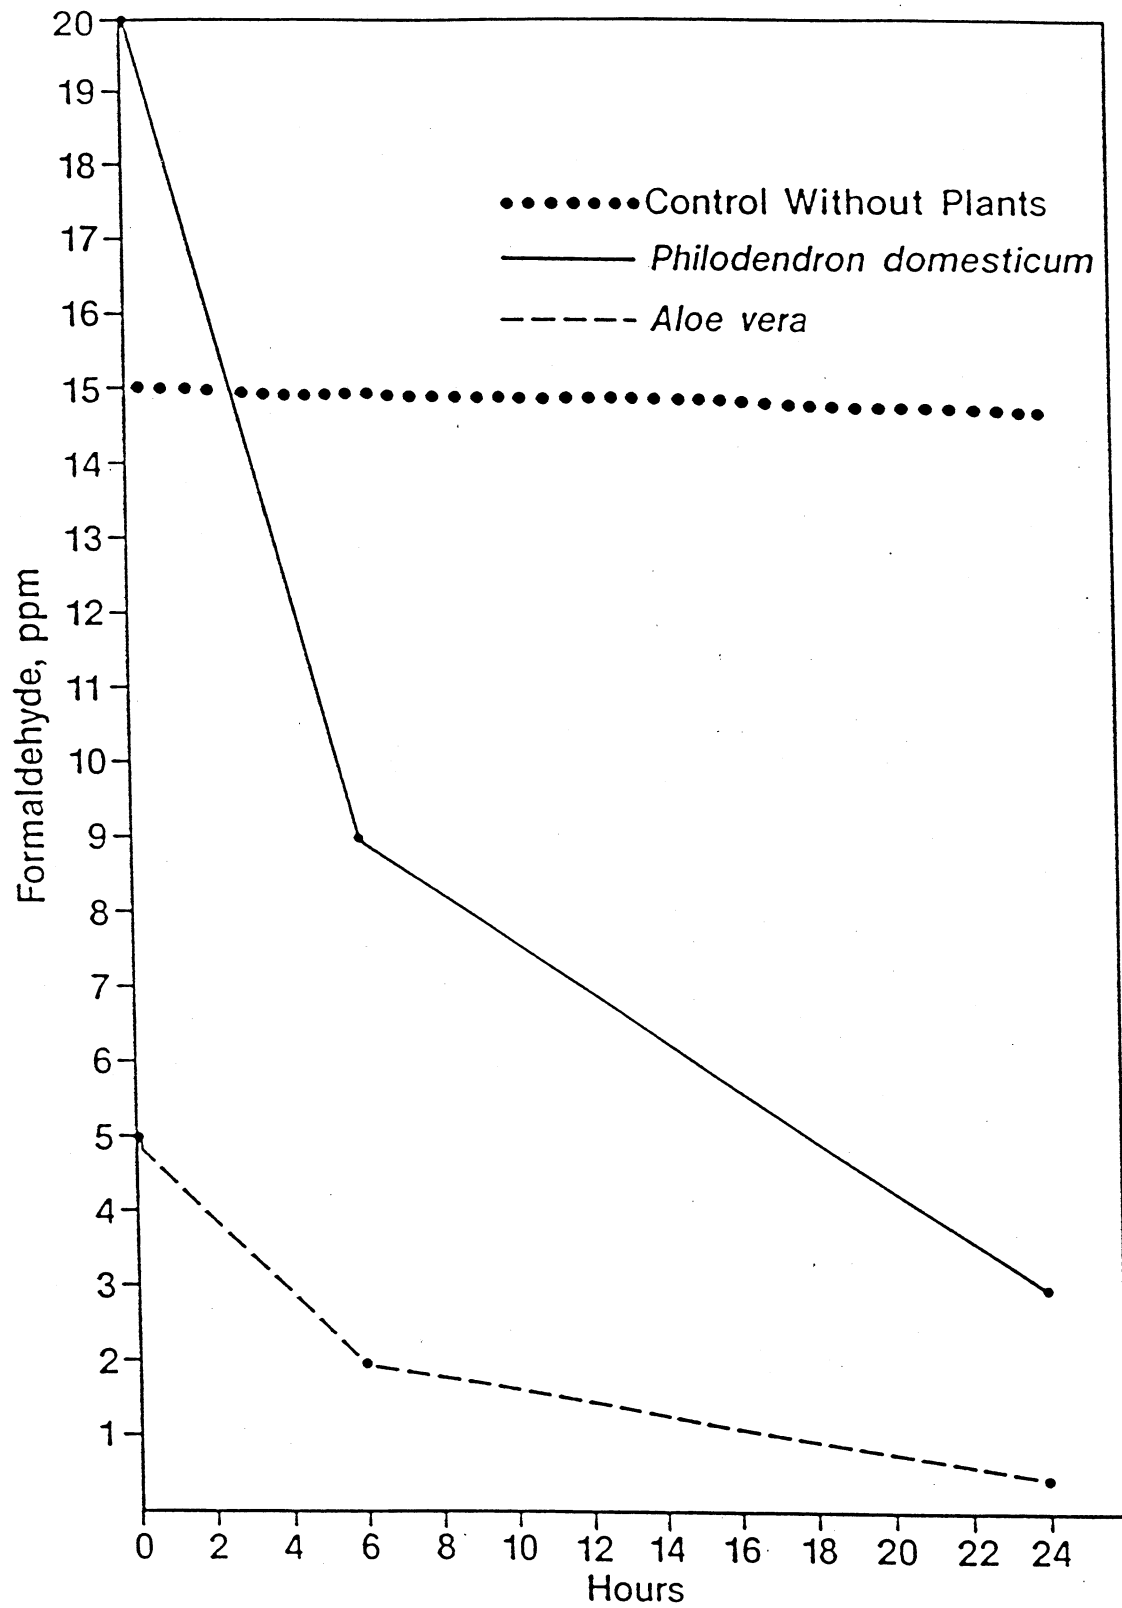


FIGURE 2

## Benzene Reduction in Closed Chamber With and Without Plants

..... Control Without Plants  
—— *Philodendron domesticum*  
---- *Scindapsus aureus*  
(Golden pothos)


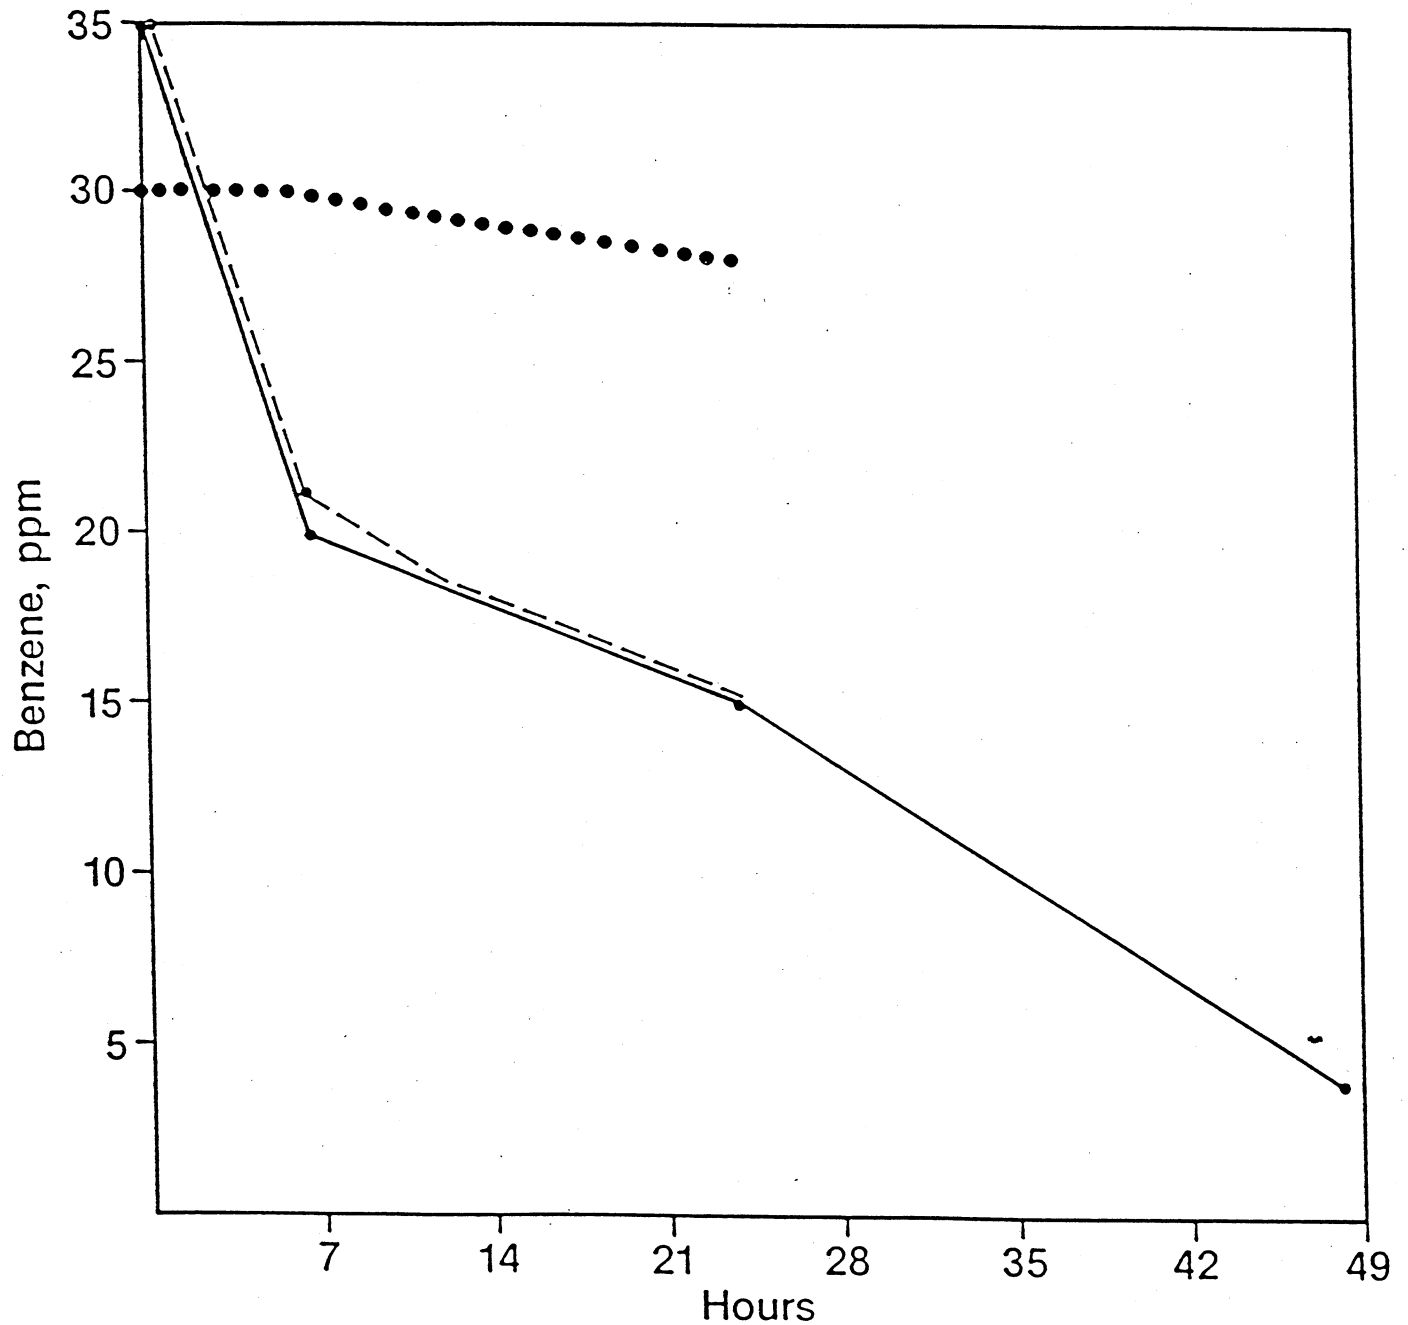


FIGURE 3

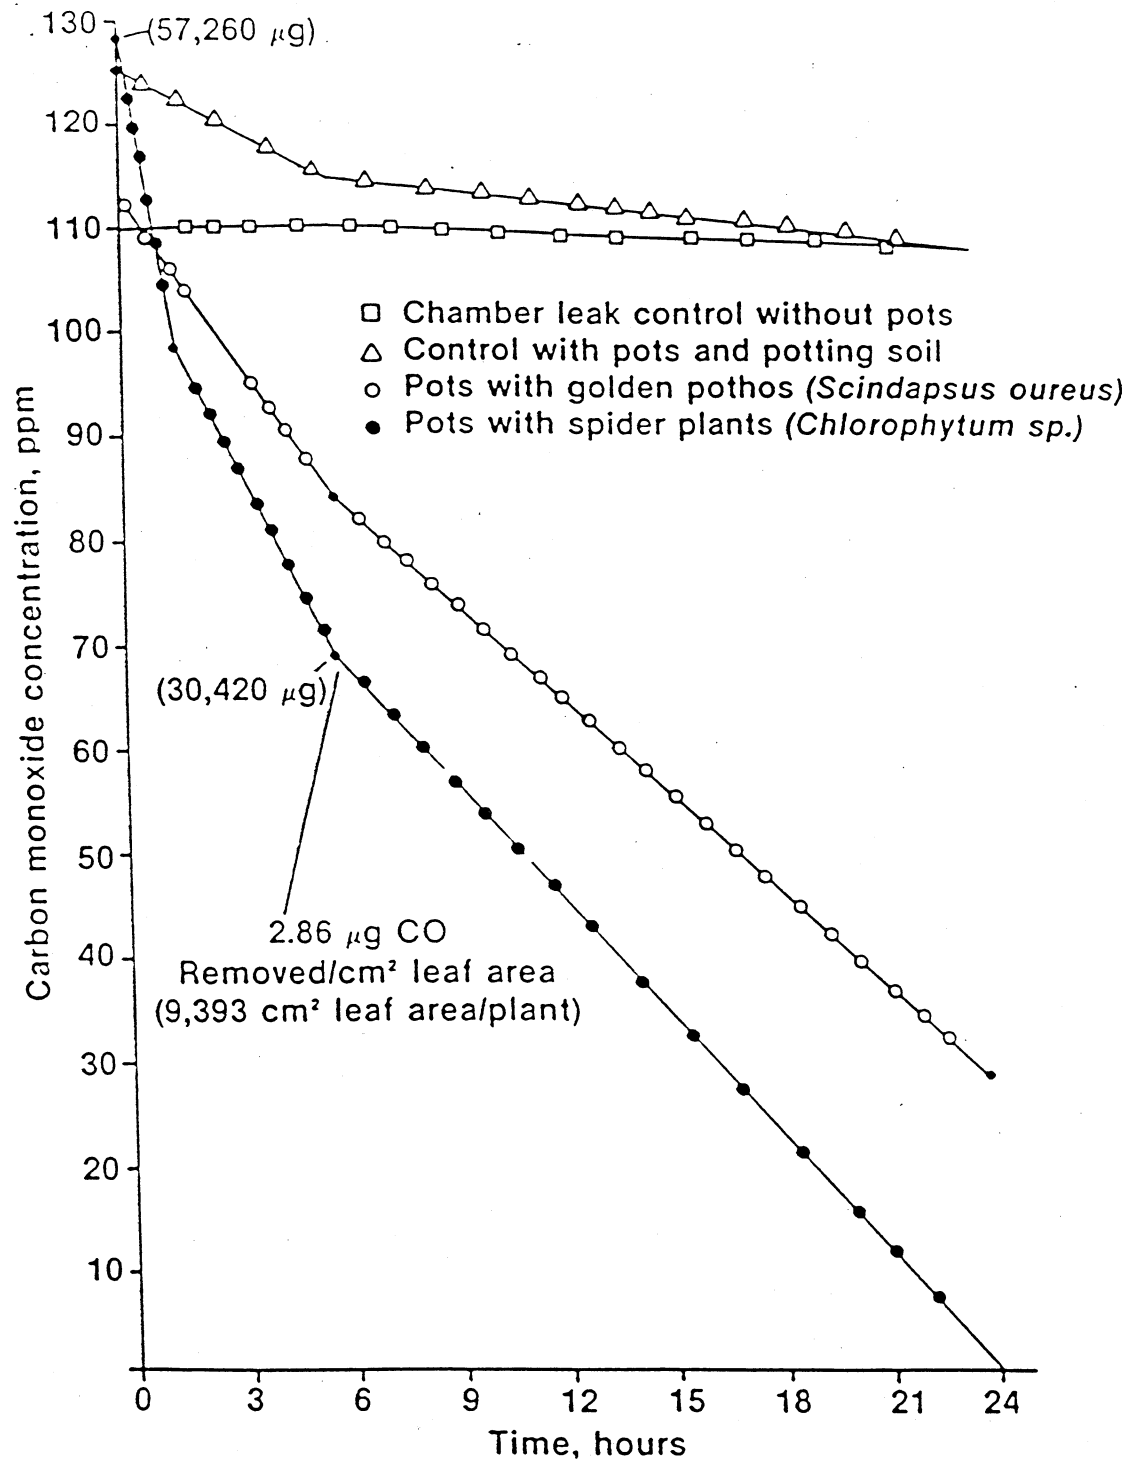

The use of spider plants and golden pothos for removing carbon monoxide from a closed chamber

TABLE 1

## FORMALDEHYDE REMOVAL DURING A 24 HOUR EXPOSURE PERIOD

Plants*	Total Formaldehyde in Chamber ( $\mu\text{g}$ )			Ave. Leaf Surface ( $\text{cm}^2$ )	$\mu\text{g}$ Formaldehyde Removal Per $\text{cm}^2$ of Leaf Area	
	Initial	After 6 hr	After 24 hr		6 hr	24 hr
<u>Philodendron oxycardium</u> (heart leaf philodendron)	11,921	5,256	3,455	1,696	3.93	4.99
<u>Philodendron domesticum</u> (elephant ear)	11,575	4,665	1,555	2,323	2.97	4.31
low concentrations	1,209	570	432	1,361	.47	.57
<u>Philodendron selloum</u> (lacy tree philodendron)	11,403	4,665	2,747	2,373	2.84	3.65
<u>Chlorophytum elatum</u> (green spider plant)	12,975	7,319	2,709	2,471	2.29	4.15
<u>Scindapsus aureus</u> (golden pothos)	10,741	4,325	1,854	2,723	2.35	3.26
<u>Aglonema modestum</u> (Chinese evergreen)	11,248	8,238	6,866	1,894	1.59	2.31
<u>Aloe vera</u>	2,592	1,037	259	713	2.18	3.27
<u>Brassaia arboricola</u> (mini-schefflera)	8,333	----	4,904	1,743	----	1.96
<u>Spathiphyllum 'clevelandii'</u> (peace lily)	10,298	6,655	5,387	3,476	1.05	1.41
<u>Peperomia obtusifolia</u> (peperomia)	10,140	6,971	5,387	3,264	0.96	1.46
<u>Uracaena fragrans 'massangeana'</u> (corn plant)	10,003	7,878	5,974	2,934	0.72	1.37
<u>Sansevieria trifasciata</u> (mother-in-law tongue)	9,330	5,636	2,954	4,881	0.76	1.31
<u>Tradescantia sillamontana</u> (oyster plant)	10,298	7,341	5,704	6,843	0.43	0.67

\*Average of three or more different experiments

TABLE 2  
BENZENE REMOVAL DURING A 24 HOUR EXPOSURE PERIOD

Plants*	Total Benzene in Chamber ( $\mu\text{g}$ )			Ave. Leaf Surface ( $\text{cm}^2$ )	$\mu\text{g}$ Benzene Removal Per $\text{cm}^2$ of Leaf Surface Area	
	Initial	6 hr	24 hr		6 hr	24 hr
<u>Gerbera jamesonii</u> (Gerbera daisy)	65,000	46,000	21,000	4620.2 (5008.0)**	3.79	8.79
<u>Chrysanthemum morifolium</u> (Mums)	57,667	49,333	27,333	1296.9 (4225.2)**	1.97	7.18
<u>Spathiphyllum mauna loa</u> (Peach lily)	27,667	17,667	11,000	7804.1	1.28	2.14
<u>Dracaena deremensis</u> "Warneckei" (Warneckei)	27,333	21,333	12,667	7239.7	0.83	2.03
<u>Dracaena marginata</u> (Marginata)	24,000	19,667	12,000	7578.2	0.57	1.58
<u>Chamaedorea seifritzii</u> (Bamboo palm)	18,500	14,000	9,000	10,322.9	0.44	0.92
<u>Dracaena deremensis</u> "Janet Craig" (Janet Craig)	23,333	18,667	12,333	15,270.0	0.31	0.72
<u>Dracaena fragans</u> "Massangeana" (Corn plant)	14,667	13,333	11,333	8,674.0	0.15	0.38

\*Average of three different experiments except Bamboo palm which was an average for two experiments.

\*\*Total surface area including flowers.



# COMPARISON OF CHEMICAL PRESENCE WITH AND WITHOUT PLANTS

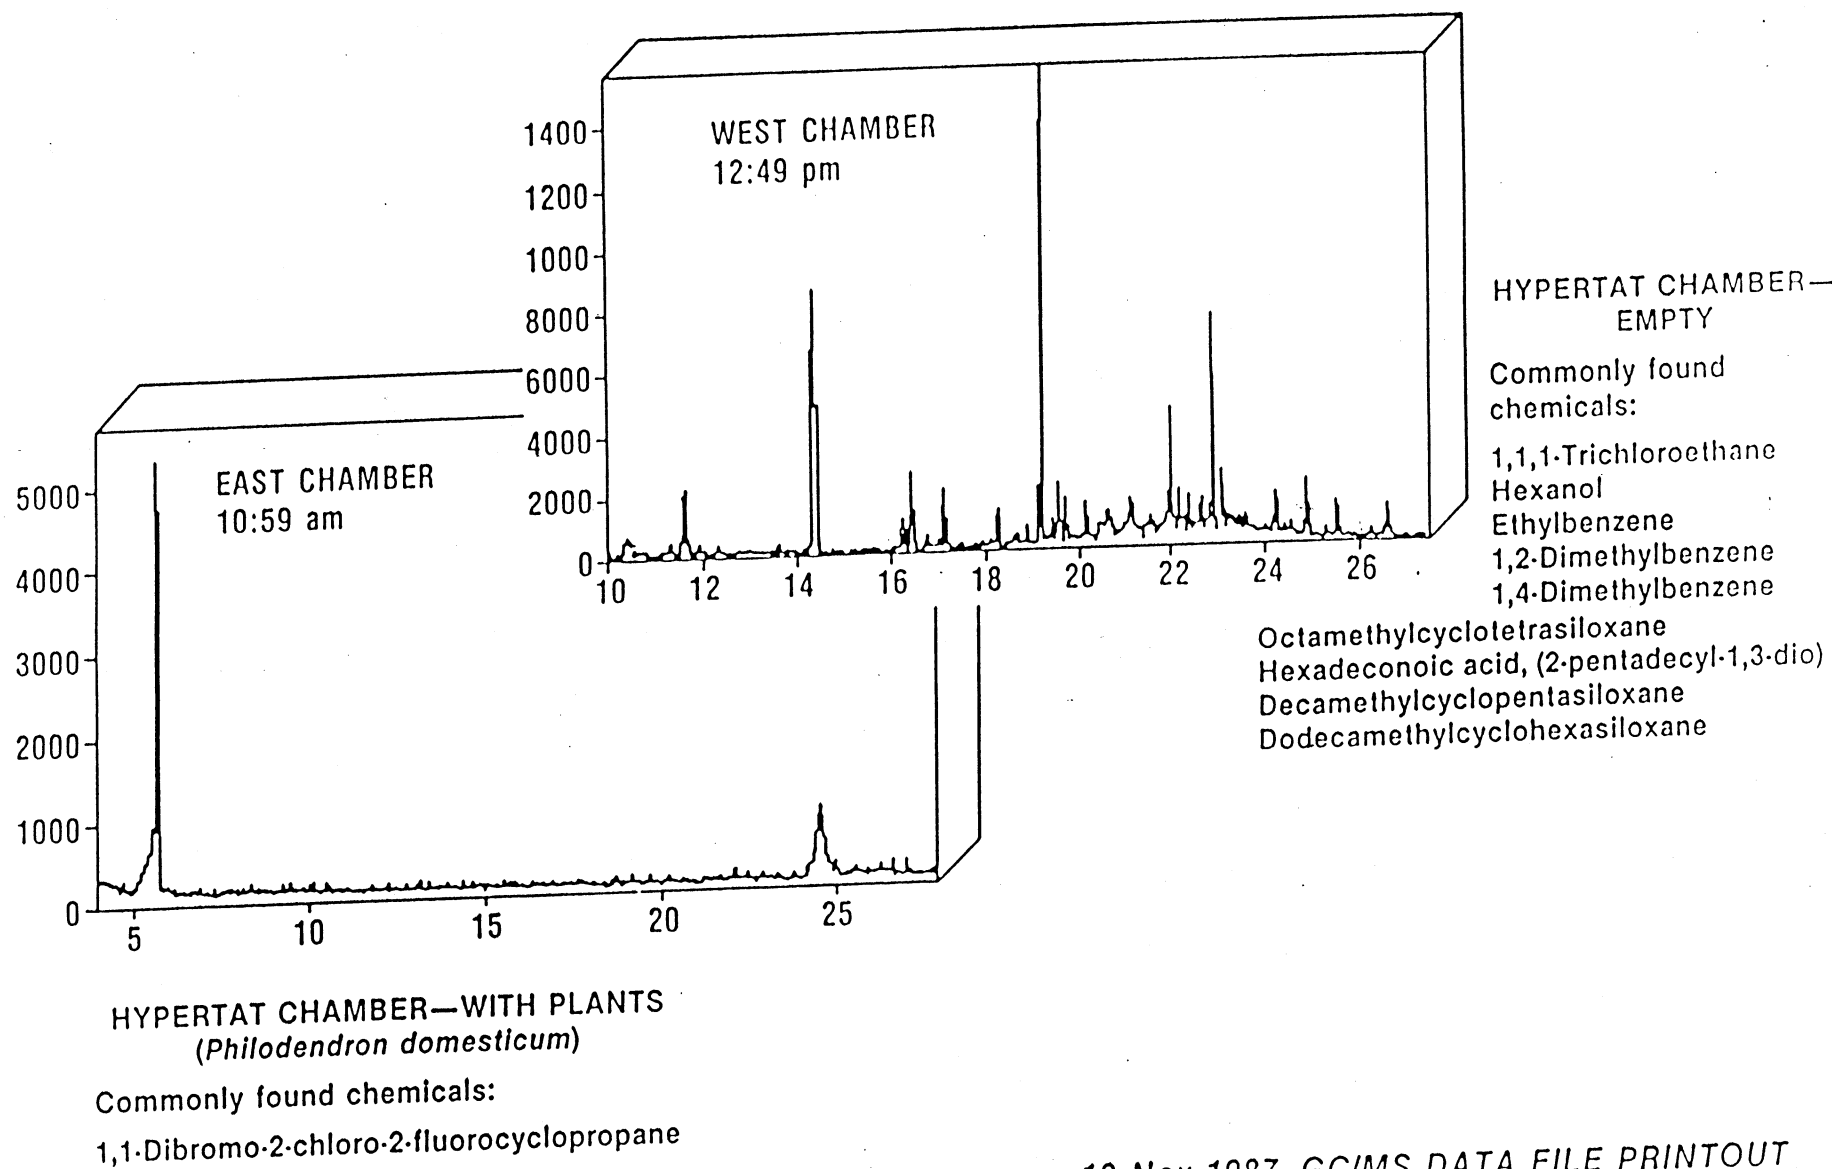


FIGURE 5

# **INDOOR AIR PURIFICATION SYSTEM COMBINING HOUSEPLANTS AND ACTIVATED CARBON**


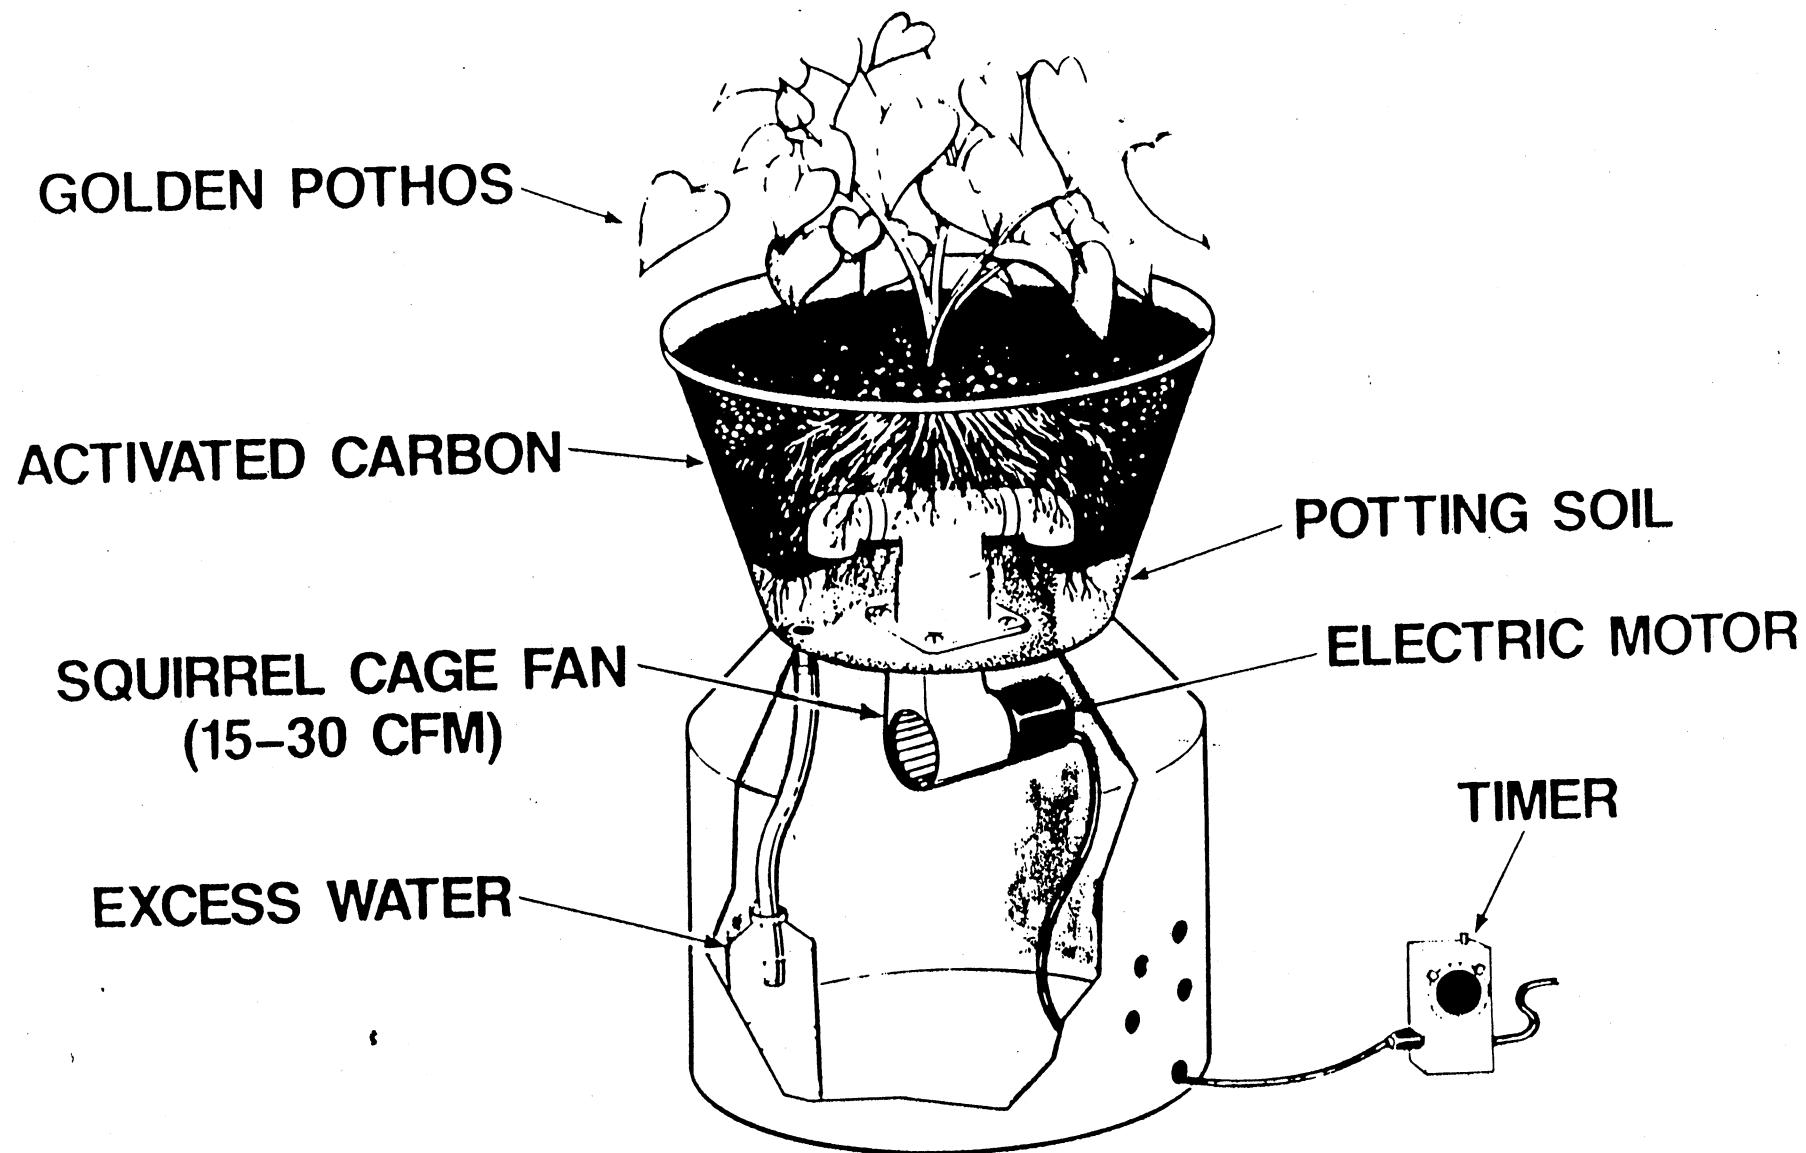


FIGURE 7

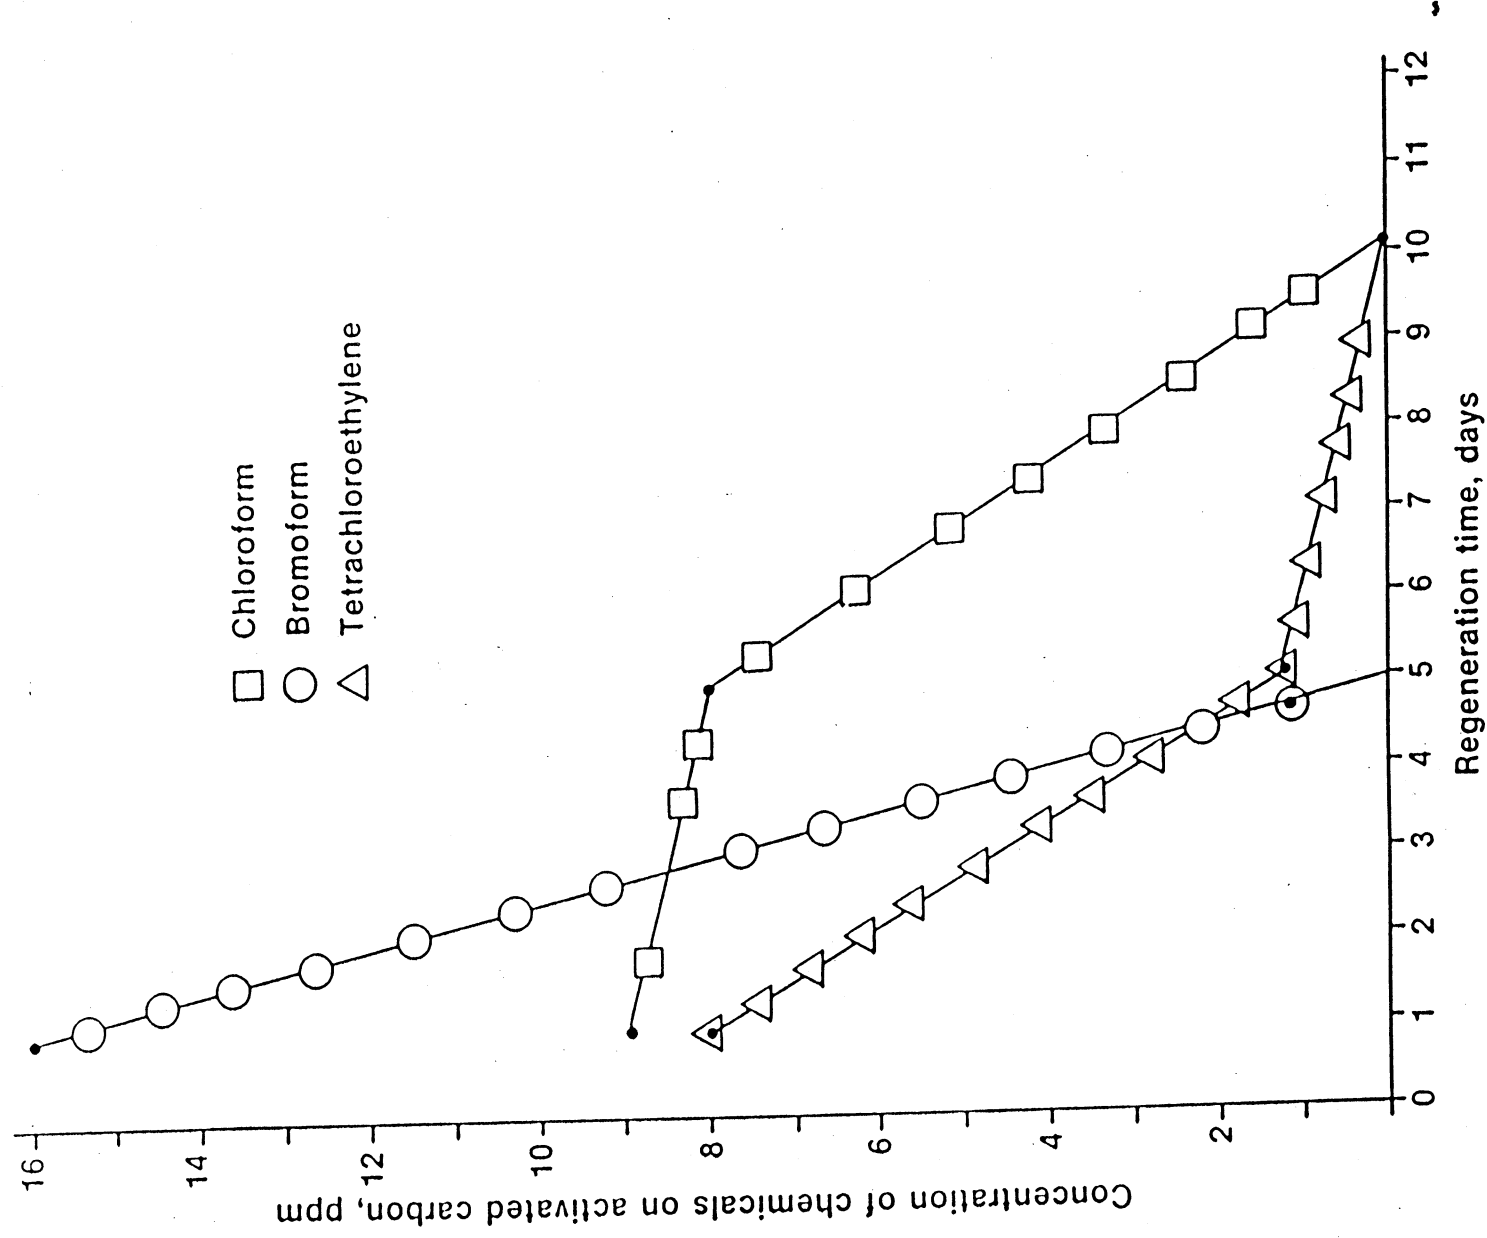

A bioregenerating activated carbon/plant system for removing toxic chemicals from indoor air and contaminated water. The detection limit is <1 ppm.

## MATERIALS AND METHODS

All plant screening studies to date have been conducted in a clear, cubical chamber, Figure 4, measuring 73.7 cm (2.4 ft) on each side and constructed of 12.7 cm (.5 in) thick Plexiglas<sup>R</sup>. Chemical analyses were performed using a Sensidyne/Gastec sampler and/or a Hewlett Packard Model 5890 gas chromatograph equipped with a Hewlett Packard Model 5970B mass selective detector and using an HP 50 m ultra-performance cross-linked 5% phenyl methyl silicone capillary column.

A super-insulated (R-40) modular structure has recently been acquired by NASA at the Stennis Space Center to study indoor air pollution problems associated with energy-efficient buildings and closed facilities for future space applications. This new structure is separated into two rooms of approximately 350 ft<sup>2</sup> each. The first experiments with this facility were to determine the indoor air pollution inside this tightly sealed structure. One side of the building was used as a control while plants were placed in the other side. This would allow for a more realistic evaluation of foliage plants for reducing indoor air pollution. Results of the initial studies are shown in Figure 5. As can be seen, dramatic reduction in the air pollution in the side containing plants is demonstrated while the side without plants maintains a large number of air pollutants.

As data is being collected on the ability of foliage plant leaves to reduce indoor air pollution levels, another exciting study using some of the same plants combined with activated carbon filters is also being conducted. The carbon/plant filter studies are designed to assess the capacity of plant

roots and their associated microorganisms to biodegrade toxic, organic chemicals absorbed on activated carbon, therefore, producing a bioregenerated carbon/plant filter. This system should be capable of removing high levels of cigarette smoke and toxic chemicals from the air inside homes and commercial buildings at a rapid rate when high capacity blower motors are used in the filters. The potential of these activated carbon/plant filters to also remove radon from inside buildings is encouraging. An artist's concept of an activated carbon/plant filter is shown in Figure 6. Data demonstrating the ability of plant roots and microorganisms to biodegrade toxic chemicals absorbed on activated carbon/plant filters is shown in Figure 7.

#### SUMMARY

NASA's research with foliage houseplants during the past 10 years has produced a new concept in indoor air quality improvement. This new and exciting technology is quite simple. Both plant leaves and roots are utilized in removing trace levels of toxic vapors from inside tightly sealed buildings. Low levels of chemicals such as carbon monoxide and formaldehyde can be removed from indoor environments by plant leaves alone, while higher concentrations of numerous toxic chemicals can be removed by filtering indoor air through the plant roots surrounded by activated carbon. The activated carbon absorbs large quantities of the toxic chemicals and retains them until the plant roots and associated microorganisms degrade and assimilate these chemicals.

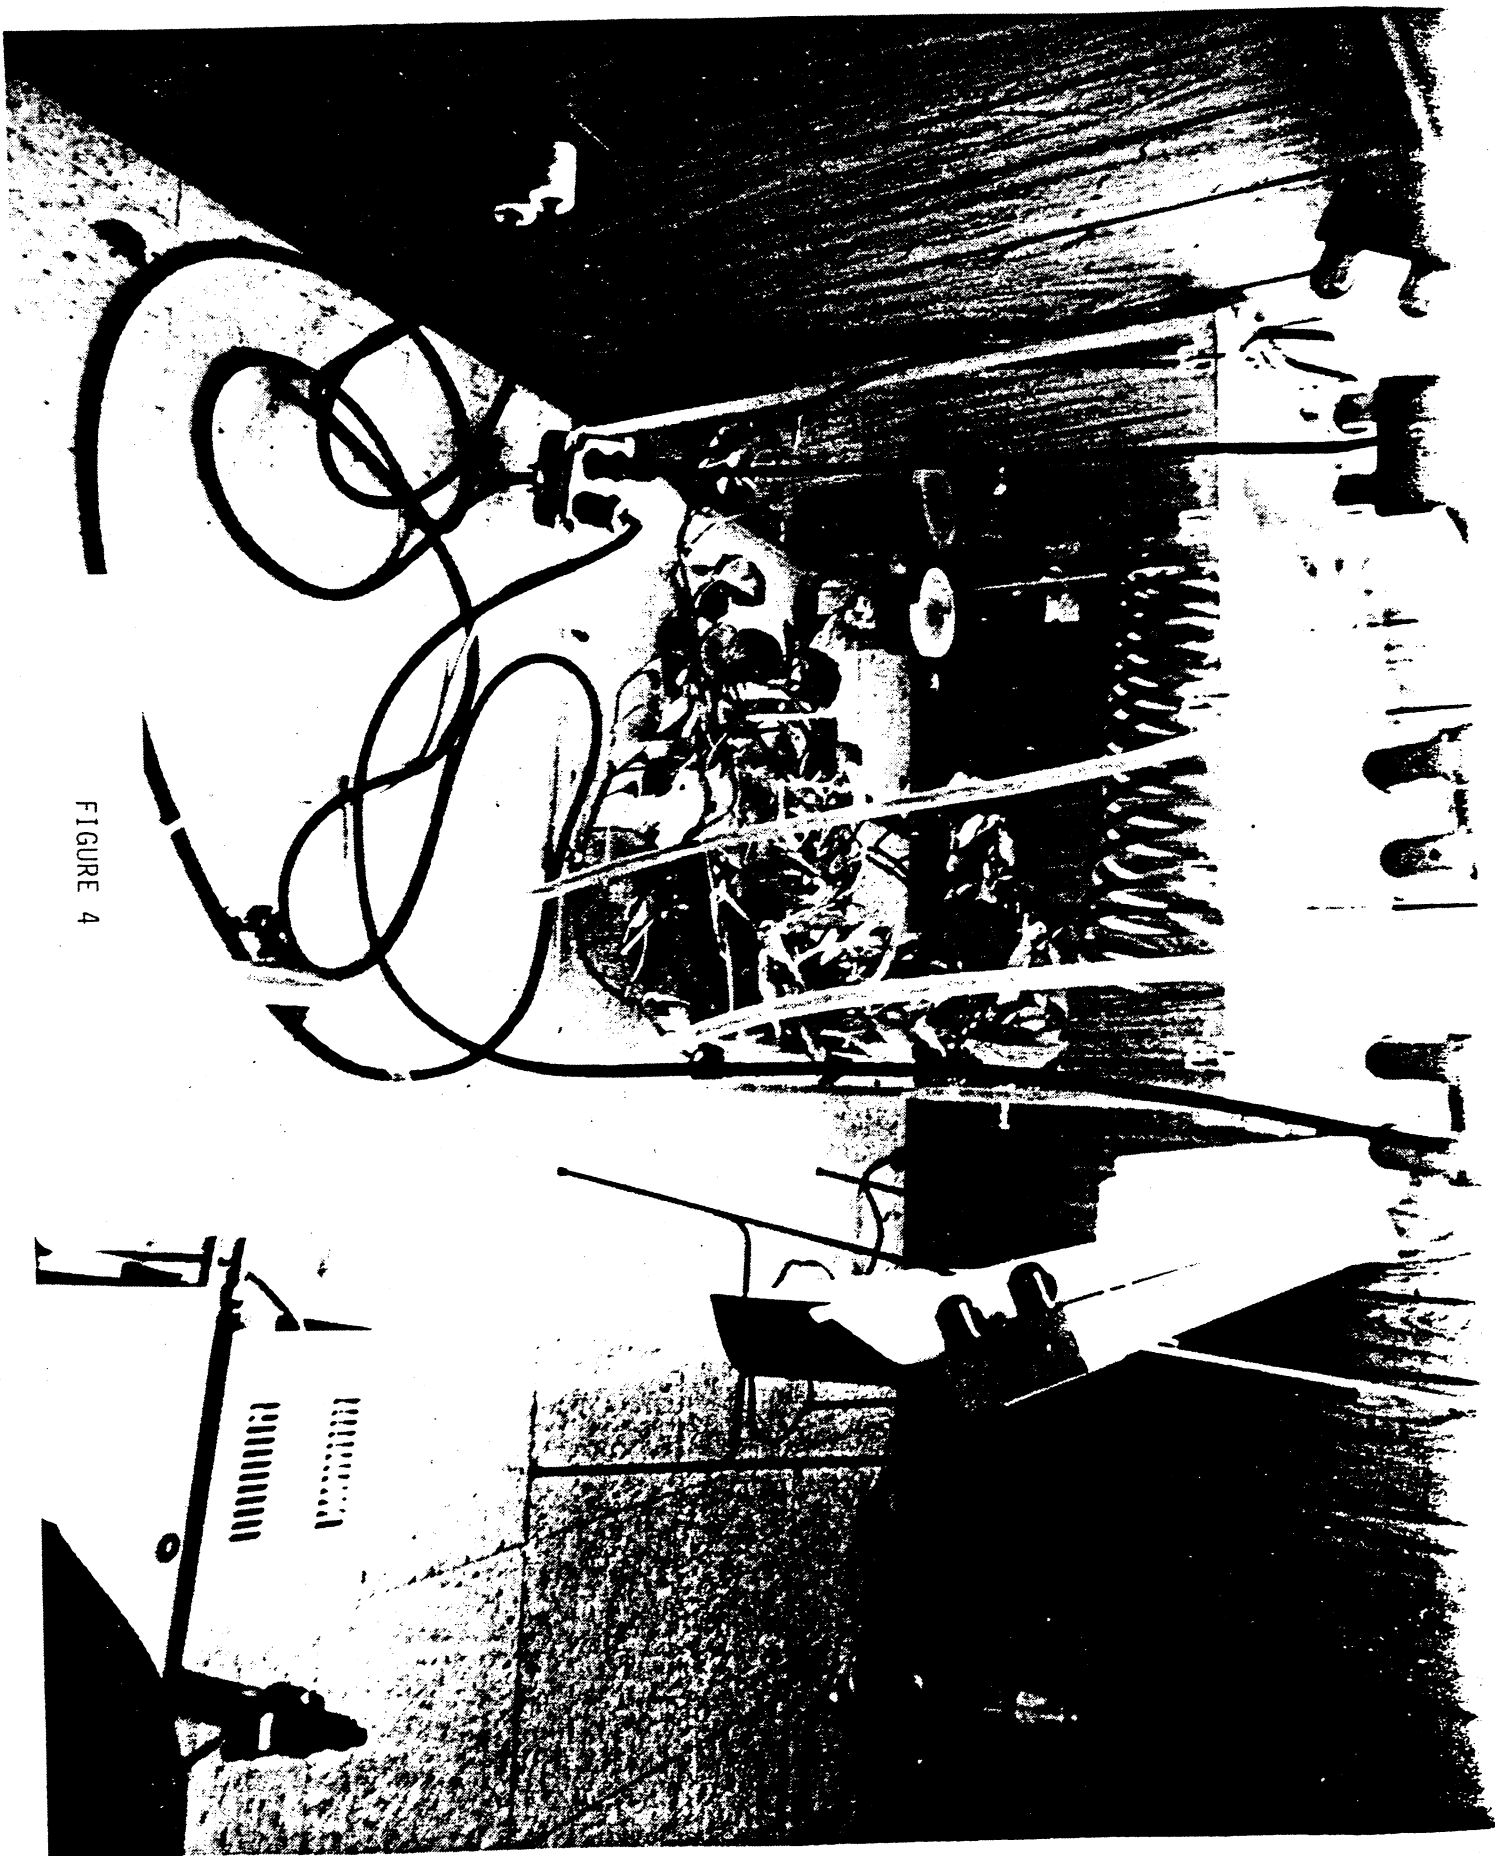


FIGURE 4

## REFERENCES

1. National Aeronautics and Space Administration. 1974. The Proceedings of the Skylab Life Sciences Symposium, August 27 - 29, 1974. NASA TM-X-58154. Johnson Space Center. 161-168.
2. Gammage, R. B. and S. V. Kaye (Eds.). 1984. Indoor Air and Human Health. Proceedings of the Seventh Life Sciences Symposium, Knoxville, TN, October 29-31, 1984. Lewis Publishers, Inc., Chelsea, MI.
3. Walsh, C., S. Dudney and E. D. Copenhauer. 1984. Indoor Air Quality. CRC Press, Inc., Boca Raton, FL.
4. Wallace, L., S. Brombert, E. Pellizzari, T. Hartwell, H. Zelon, and L. Sheldon. 1984. Plan and preliminary results of the U. S. Environmental Protection Agency's indoor air monitoring program (1982). In: Indoor Air, Swedish Council for Building Research, Stockholm, Sweden. 1:173-178.
5. Pellizzari, E. D., M. D. Erickson, M. T. Giguere, T. D. Hartwell, S. R. Williams, C. M. Sparacino, H. Zelon, and R. D. Waddell. 1980. Preliminary Study of Toxic Chemicals in Environmental Human Samples: Work Plan, Vols I and II, (Phase I). U. S. EPA, Washington, DC.
6. Pellizzari, E. D., M. D. Erickson, C. M. Sparacino, T. C. Hartwell, H. Zelon, M. Rosenweig, and C. Leininger. 1981. Total Exposure Assessment Methodology (TEAM) Study: Phase II: Work Plan. U. S. EPA, Washington, DC.
7. Wallace, L., R. Zweidinger, M. Erickson, S. Cooper, D. Whittaker, and E. Pellizzari. 1982. Monitoring individual exposure: measurements of volatile organic compounds in breathing-zone air, drinking water, and exhaled breath. Env. Int., 8:269-282.
8. Pellizzari, E. D., T. Hartwell, H. Zelon, C. Leininger, M. Erickson, S. Cooper, D. Whittaker, and L. Wallace. 1982. Total Exposure Assessment Methodology (TEAM) Prepilot Study -- Northern New Jersey. U. S. EPA, Washington, DC.
9. Sparacino, C., C. Leininger, H. Zelon, T. Hartwell, M. Erickson, and E. Pellizzari. 1982. Sampling and Analysis for the Total Exposure Assessment Methodology (TEAM) Prepilot Study. Research Triangle Park, NC. U. S. EPA, Washington, DC.
10. Sparacino, C., E. Pellizzari, and M. Erickson. 1982. Quality Assurance for the Total Exposure Assessment Methodology (TEAM) Prepilot Study. U. S. EPA, Washington, DC.

11. Pellizzari, E. D., T. D. Hartwell, C. Leininger, H. Zelon, S. Williams, J. Breen, and L. Wallace. 1983. Human exposure to vapor-phase halogenated hydrocarbons: fixed-site vs. personal exposure. Proceedings from Symposium on Ambient, Source, and Exposure Monitoring Systems Lab., Research Triangle Park, NC. EPA 600/99-83-007. U. S. EPA, Washington, DC.
12. Wallace, L., E. Pellizzari, T. Hartwell, M. Rosenweig, M. Erickson, C. Sparacino, and H. Zelon. 1984. Personal exposure to volatile organic compounds: I. direct measurement in breathing-zone air, drinking water, food and exhaled breath. *Env. Res.*, 35:193-211.
13. Pellizzari, E., T. Hartwell, C. Sparacino, C. Shelton, R. Whitmore, C. Leininger, and H. Zelon. 1984. Total Exposure Assessment Methodology (TEAM) Study: First Season, Northern New Jersey -- Interim Report. Contract No. 68-02-3679. U. S. EPA, Washington, DC.
14. Hartwell, T. C., R. L. Perritt, H. X. Zelon, R. W. Whitmore, E. D. Pellizzari, and L. Wallace. 1984. Comparison of indoor and outdoor levels of air volatiles in New Jersey. In: *Indoor Air*, Swedish Council for Building Research, Stockholm, Sweden. 4:81-86.
15. Pellizzari, E., C. Sparacino, L. Sheldon, C. Leininger, H. Zelon, T. Hartwell, and L. Wallace. 1984. In: *Ibid.* 4:221-226.
16. Wallace, L., E. Pellizzari, T. Hartwell, H. Zelon, C. Sparacino, and R. Whitmore. 1984. Analysis of exhaled breath of 355 urban residents for volatile organic compounds. In: *Ibid.* 4:15-20.
17. Rosenweig, M. and T. D. Hartwell. 1983. Statistical Analysis and Evaluation of the Halocarbon Survey. Research Triangle Institute, Final Report, EPA Contract 68-01-5848. U.S. EPA, Washington, DC.
18. Hartwell, T. D., H. X. Zelon, C. C. Leininger, C. A. Clayton, J. H. Crowder, and E. D. Pellizzari. 1984. Comparative statistical analysis for volatile halocarbons in indoor and outdoor air. In: *Indoor Air*, Swedish Council for Building Research, Stockholm, Sweden. 4:57-62.
19. Molhave, L., and J. Moller. 1979. The atmospheric environment in modern Danish dwellings: measurements in 39 flats. *Indoor Climate*. Danish Building Research Institute, Copenhagen, Denmark. 171-186.
20. Jarke, F. H. 1979. ASHRAE Report 183. IITRI, Chicago, IL.
21. Lebrecht, E. H., J. Van de Wiel, H. P. Box, D. Noij, and J. S. M. Boleij. 1984. Volatile hydrocarbons in Dutch homes. In: *Indoor Air*, Swedish Council for Building Research, Stockholm, Sweden. 4:169-174.



22. Seifert, B. and H. J. Abraham. 1982. Indoor air concentrations of benzene and some other aromatic hydrocarbons. *Ecotoxicol. Environ. Safety*, 6:190-192.
23. De Bortoli, M., H. Knoppel, E. Pecchio, A. Peil, L. Rogora, H. Schauenberg, H. Schlitt, and H. Vissers. 1984. Integrating 'real life' measurements of organic pollution in indoor and outdoor air of homes in northern Italy. In: *Indoor Air*, Swedish Council for Building Research, Stockholm, Sweden. 4:21-26.
24. Gammage, R. B., D. A. White, and K. C. Gupta. 1984. Residential measurements of high volatility organics and their sources. In: *Ibid.* 4:157-162.
25. Monteith, D. K., T. H. Stock, and W. E. Seifert, Jr. 1984. Sources and characterization of organic air contaminants inside manufactured housing. In: *Ibid.* 4:285-290.
26. National Research Council, Committee on Toxicology. 1980. Formaldehyde-an assessment of its health effects. National Academy of Sciences, Washington, DC.
27. National Research Council, Committee on Aldehydes. 1981a. Formaldehyde and other aldehydes. National Academy Press, Washington, DC.
28. National Research Council, Committee on Indoor Pollutants. 1981b. Indoor pollutants. National Academy Press, Washington, DC.
29. Wolverton, B. C., R. C. McDonald and E. A. Watkins, Jr. 1984. Foliage plants for removing indoor air pollutants from energy efficient homes. *Econ. Bot.*, 38(2):224-228.
30. Wolverton, B. C., R. C. McDonald and H. H. Mesick. 1985. Foliage plants for the indoor removal of the primary combustion gases carbon dioxide and nitrogen dioxide. *J. MS Acad. Sci.*, 30:1-8.
31. Wolverton, B. C. 1987. Artificial marshes for wastewater treatment. In: K. R. Reddy and W. H. Smith (Eds.), *Aquatic plants for wastewater treatment and resource recovery*. Magnolia Publishing Inc., Orlando, FL. pp. 141-152.
32. Wolverton, B. C. 1987. Natural systems for wastewater treatment and water reuse for space and earthly applications. In: *Proceedings of American Water Works Association Research Foundation, Water Reuse Symposium IV, August 2-7, 1987*. Denver, CO, pp. 729-741.
33. Wolverton, B. C. 1987. Aquatic plants for wastewater treatment: an overview. In: K. R. Reddy and W. H. Smith (Eds.), *Aquatic plants for wastewater treatment and resource recovery*. Magnolia Publishing Inc., Orlando, FL. pp. 3-15.